



REPEAT FORMATION TESTER PRESSURE COMPARISONS

CITIES SERVICE CO. GARDEN CITY E-2
 SECTION 32 T-23-S R-34-W
 FINNEY COUNTY, KANSAS

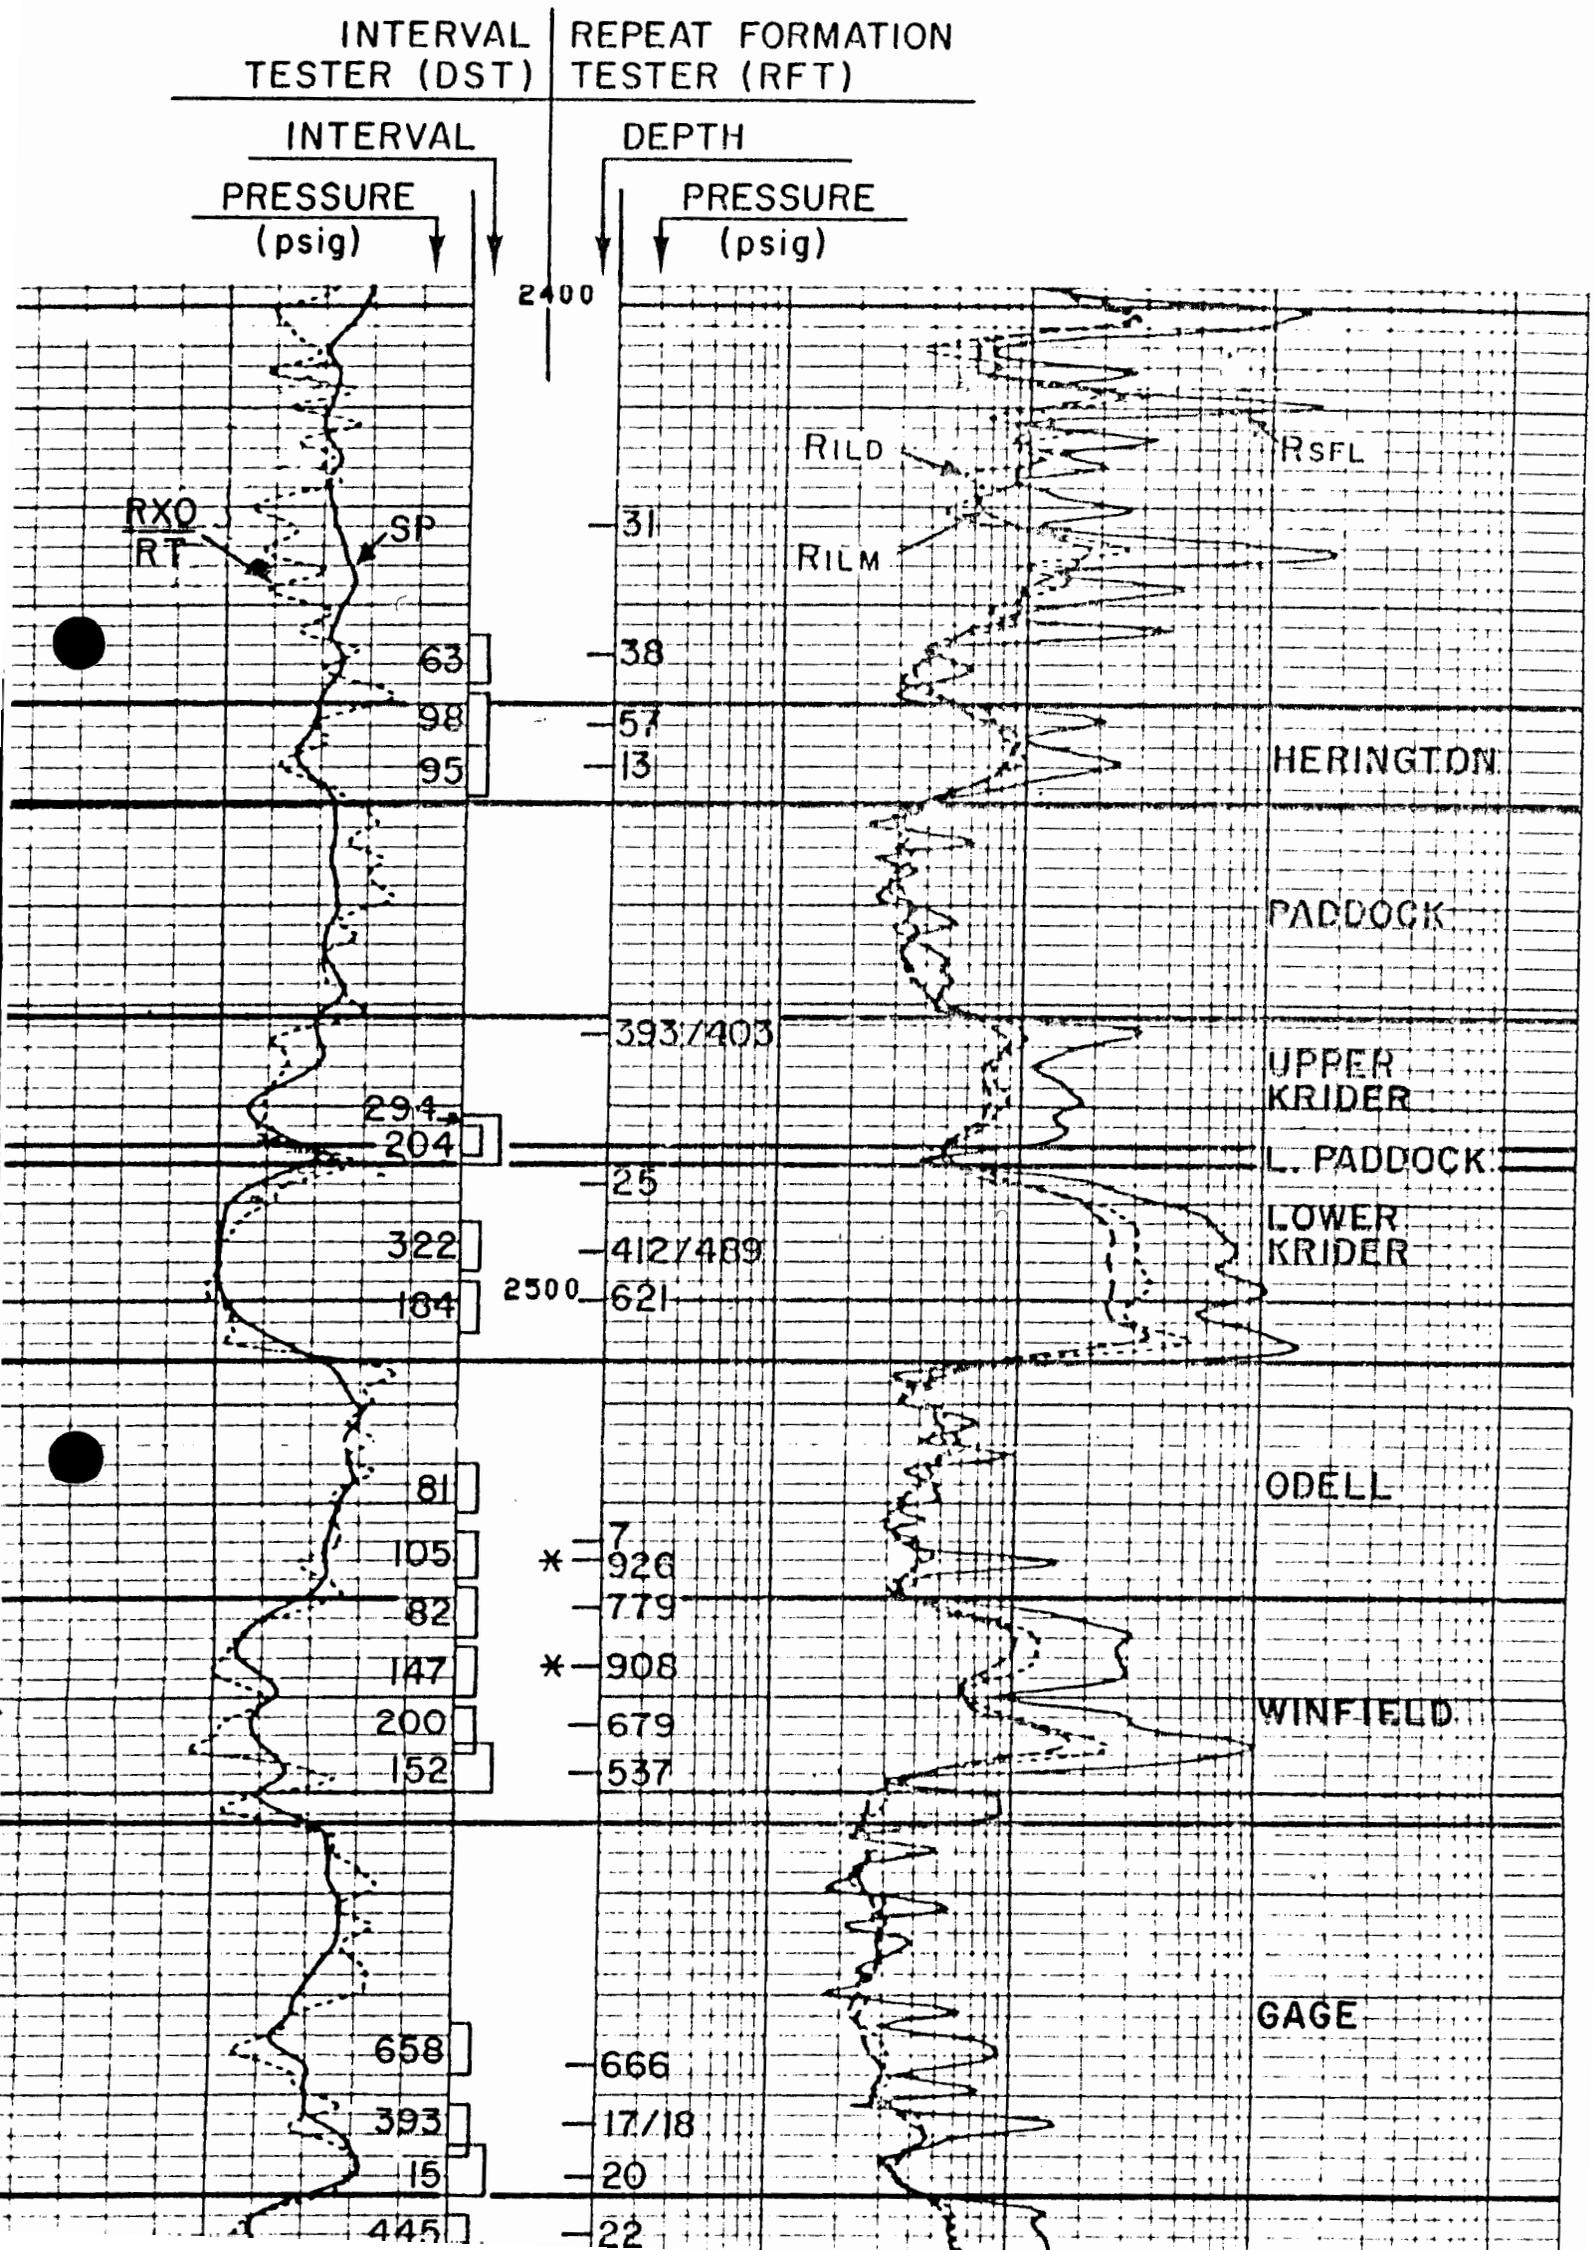

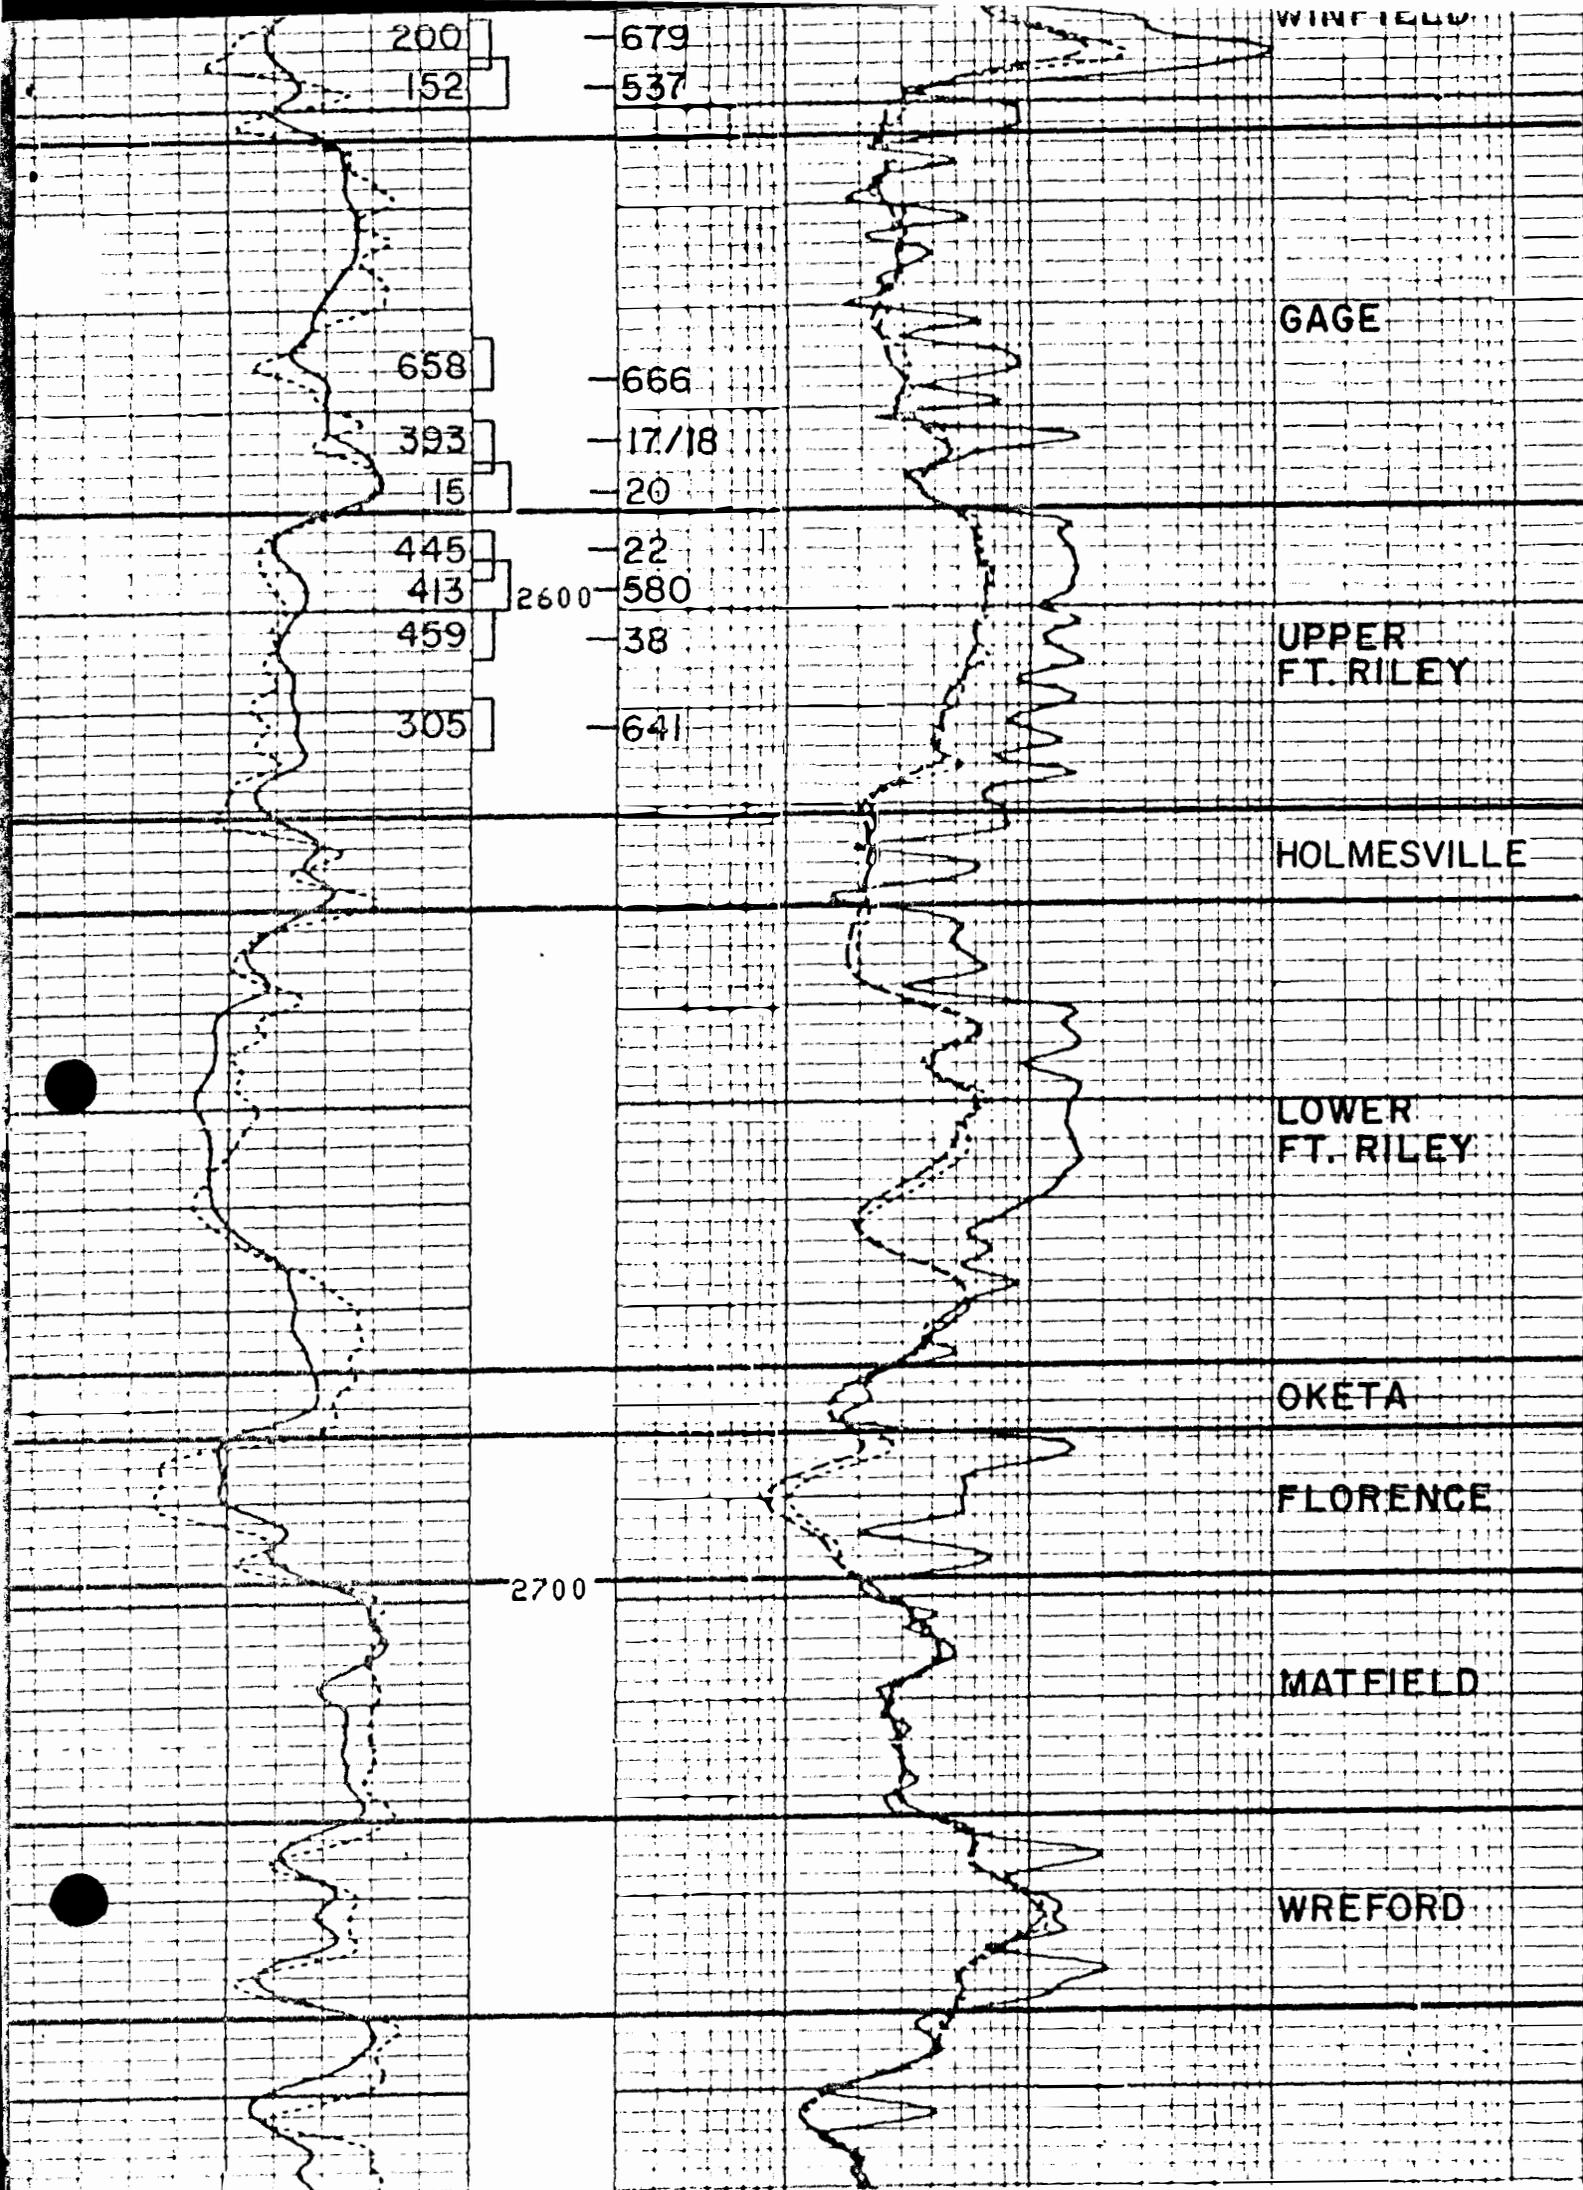

* PROBABLE PACKER LEAK OR FRACTURES

PANHANDLE EASTERN PIPE LINE COMPANY

KANSAS HUGOTON FIELD

Exhibit No. 101

Docket No. C-164

Date: May 22, 1985

Witness: J.W. CRAFTON